

Guangdong ACG Windows & Doors & Curtain Wall Co. Ltd

TEST REPORT

SCOPE OF WORK

Window and Door

REPORT NUMBER


220223081GZU-005

ISSUE DATE

2022/4/7

PAGES

20

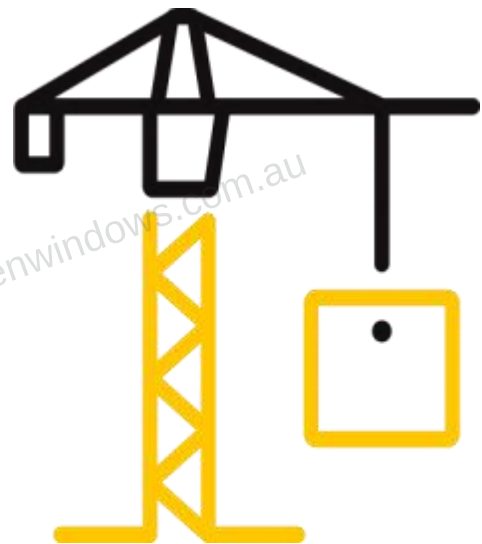

Intertek Testing Services Shenzhen Ltd. Guangzhou Branch

DOCUMENT CONTROL NUMBER

TTRF_AS 2047_b

Effective date: 2021-9-1

© 2021 Intertek

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

Applicant: Guangdong ACG Windows & Doors & Curtain Wall Co. Ltd
Applicant Address: GuTangNorth Road Dawang High tech Industrial Zone, Zhaoqing, Guangdong, China.
Attn: Xinfang Zhang

Manufacturer: /
Manufacturer Address: /
Attn: /

SUBJECT: Performance testing
< ACG100-220 Sliding Door >

Dear Sir,

This test report for represents the results of our evaluation of the above referenced product(s) to the requirements contained in the following standards:

TEST METHODS AND STANDARDS
AS 2047:2014 Windows and external glazed doors in buildings

SAMPLE ID	MODEL	SPECIFICATION
S220223081GZU.005	ACG100-220 Sliding Door	4050 mm (Width) × 2650 mm (Height) × 238 mm (Thickness)

SAMPLE RECEIVED: 2022/2/23
TESTED FROM: 2022/3/12 TO 2022/3/12

TEST LOCATION: C2 - 1 Building Heping Fair, Yongning Street, Zengcheng District, Guangzhou, China

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. All the tests results give the statement of conformity refer to the decision rule of "Procedure 2 "Accuracy Method" as stated in the IEC Guide 115:2007.

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

Test Items, Method and Results:

1 Test Samples

A full scale of sample was provided by the manufacturer that was not weathered nor conditioned. The description of the samples given below has been prepared from information provided by the sponsor of the test. All values quoted are nominal, unless tolerances are given.

Table 1 Product Information

1	Product Name	ACG100-220 Sliding Door
2	Model	ACG100-220 Sliding Door
3	Dimension of Door Frame	4050mm (Width) x2650mm (Height) x 238 mm (Thickness)
4	Dimension of Door Sash	Operable Sash: 1350 (Width) x 2550 mm (Height) x 40mm (Thickness) quantity: 2 Fixed Sash: 1350 (Width) x 2550 mm (Height) x 40mm (Thickness)
5	Aluminum Profile	Model: ACG100-220 Manufacturer: Guangdong ACG Windows & Doors & Curtain Wall Co. Ltd
6	Frame Corner Construction Details	Mechanically assembled: Screw: ST4.2 * 3.5
7	Reinforcement	None
8	Glazing	Operable Sash: 1275(Width) x 2420 mm (Height), quantity: 2 Fixed Sash: 1275(Width) x 2550 mm (Height) Structure: 6 mm+12 A+6 mm tempered double glazing Supplier: XIYI
9	Hardware	Model: DS2130 Supplier: Doric
10	Weather- strip	Model: 6*8, 7*15 Material: wool top Supplier: LiDe
11	Thermal Break	Model: C14.8 Material: PA66+25%F Supplier: Yile
12	Drainage	Sizes: 40 mmx 8 mm (Width x Height) quantity: 11
13	Gasket (between sash and frame)	Material: EPDM Supplier: haiDa
14	Sealant of Glass	Model: ss511 Neutral silicone sealant Material: silicone sealant Supplier: baiyun
15	Installation	The rough opening allowed for a 10 mm shim space. The exterior perimeter of the test specimen was sealed with silicone sealant.

Test Report

Issue Date: 2022/4/7

Intertek Report No. 220223081GZU-005

Test Items, Method and Results:

2 Test Result

Table 2 Test Results

Test Description	Test Result				Rating	Verdict
Deflection / Span Ratio AS/NZS 4420. 1-2016 section 3	Serviceability Design Wind Pressure		± 800 Pa		N4 (General)	Pass
	Structural member # 1 : <i>Stile at handle side</i>		1/1114			
	Structural member # 2 : <i>Interlocking stile</i>		1/454			
	Structural member # 3 : <i>Fixed sash stile</i>		1/275			
Operating Force AS/NZS 4420. 1-2016 section 4	First sliding sash	Initial Movement Requirement: < 180N	Open	164N	/ 	

Test Report

Issue Date: 2022/4/7

Intertek Report No. 220223081GZU-005

Table 2 Test Results (Cont.)

Test Description	Test Result			Rating	Verdict
Ultimate Strength Test AS/NZS 4420. 1-2016 section 7	±	2000	Pa with no collapse	N4 (General)	Pass
	Description: No significant breakage, permanent deformation or operational malfunction after ultimate strength was released.				

Test Report

Issue Date: 2022/4/7

Intertek Report No. 220223081GZU-005

Appendix A: Test Data and Sample Drawings:

A.1 Deflection Test – Test method AS/NZS 4420.1-2016

Test Pressure (Serviceability design wind pressure), $P=800$ Pa, rating N4 (General).

Note : No structural members in a completely assembled and glazed window shall deflect by an amount greater than the following, when tested at the serviceability design wind pressure:

- (a) Span/250 for windows and sliding doors
- (b) Span/100 for doors other than sliding

Table 3 Test Data of Deflection Test

Member (mm)		Test Pressure (Pa)	Displacement(mm)			Actual Deflection	Deflection/ Span Ratio
Item	Span Length		1	2	3		
Stile at handle side	2450	+P/4=200	0.1	1.1	0.2	1.0	/
		+2P/4=400	0.6	1.9	0.2	1.5	/
		+3P/4=600	1.5	2.9	0.5	1.9	/
		+4P/4=800	2.3	3.7	1.1	2.0	1:1225
		0	0.6	0.5	0.6	0.0	/
Stile at handle side	2450	-P/4=-200	0.0	0.8	0.2	0.7	/
		-2P/4=-400	0.5	1.6	0.2	1.3	/
		-3P/4=-600	1.0	2.5	0.2	1.9	/
		-4P/4=-800	1.7	3.4	0.8	2.2	1:1114
		0	0.7	0.6	0.6	0.1	/

Table 4 Test Data of Deflection Test

Member (mm)		Test Pressure (Pa)	Displacement(mm)			Actual Deflection	Deflection/ Span Ratio
Item	Span Length		4	5	6		
Interlocking stile	2450	+P/4=200	1.1	2.0	0.4	1.3	/
		+2P/4=400	2.5	4.2	1.2	2.4	/
		+3P/4=600	3.9	6.6	2.1	3.6	/
		+4P/4=800	5.0	8.8	2.9	4.9	1:500
		0	1.0	1.0	1.0	<0.1	/
Interlocking stile	2450	-P/4=-200	1.9	2.5	0.7	1.2	/
		-2P/4=-400	3.9	5.6	2.1	2.6	/
		-3P/4=-600	5.8	8.8	3.9	4.0	/
		-4P/4=-800	7.3	11.4	4.8	5.4	1:454
		0	1.0	0.9	1.0	<0.1	/

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

A.1 Deflection Test – Test method AS/NZS 4420.1-2016 (Cont.)

Table 5 Test Data of Deflection Test


Member (mm)		Test Pressure (Pa)	Displacement(mm)			Actual Deflection	Deflection/ Span Ratio
Item	Span Length		7	8	9		
Fixed sash stile	2450	+P/4=200	0.7	2.8	0.2	2.4	/
		+2P/4=400	1.8	5.6	0.5	4.5	/
		+3P/4=600	2.8	8.5	1.0	6.6	/
		+4P/4=800	3.6	11.3	1.7	8.7	1:282
		0	0.4	1.0	0.5	0.6	/
Fixed sash stile	2450	-P/4=-200	1.4	3.1	0.2	2.3	/
		-2P/4=-400	2.7	6.1	0.5	4.5	/
		-3P/4=-600	4.1	9.5	1.2	6.9	/
		-4P/4=-800	5.3	12.4	1.8	8.9	1:275
		0	0.5	1.0	0.4	0.6	/

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

A. 2 Sample Drawings

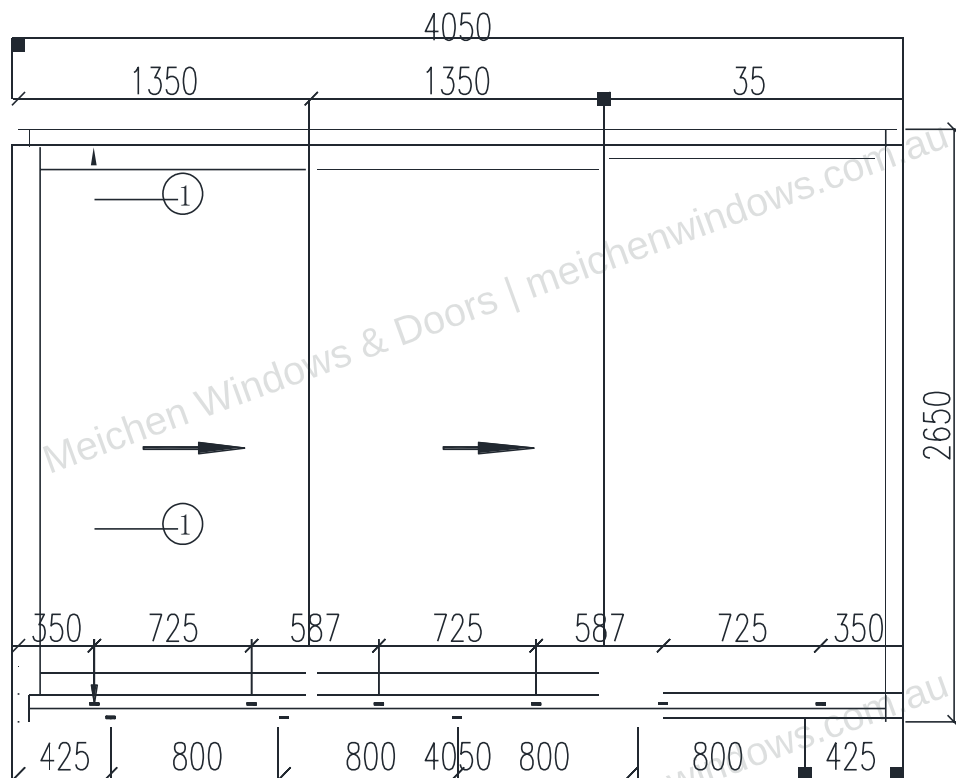

① pressure-relief vent ② drainage location

Fig. 1 Drawing of Representative Sample

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

A. 2 Sample Drawings(Cont.)

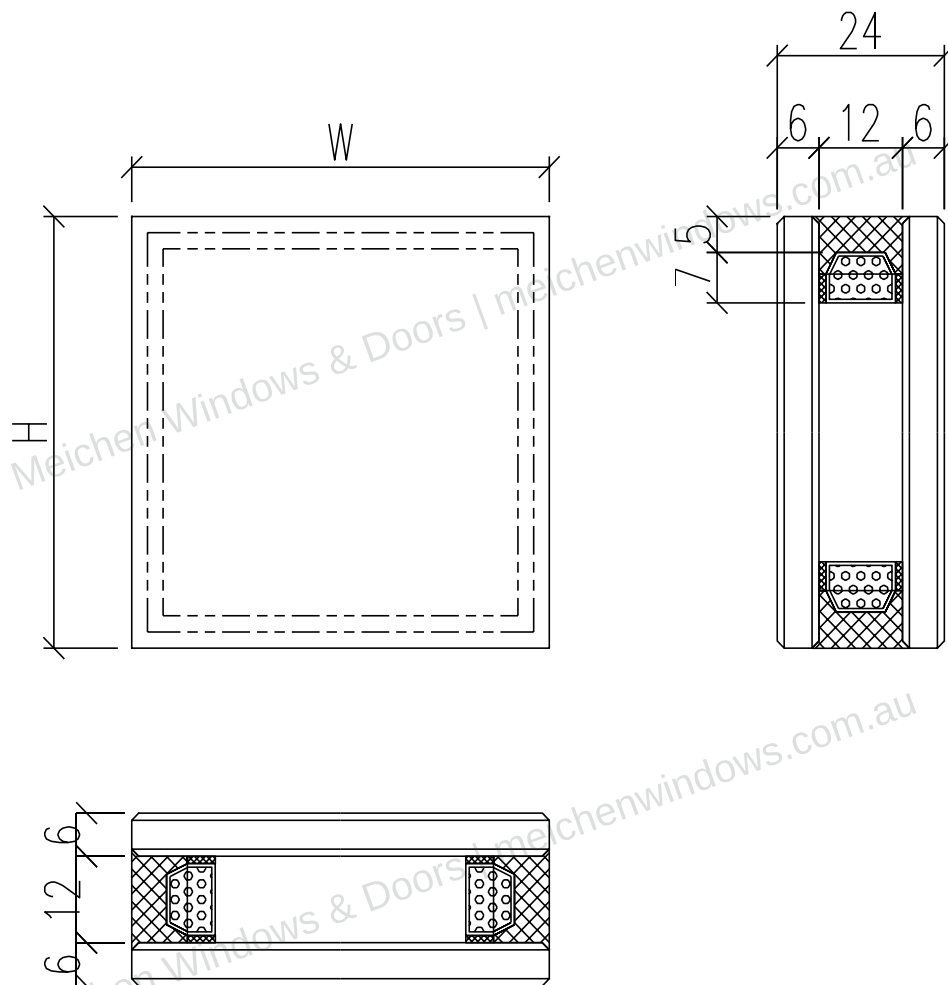


Fig. 9 Drawing of glazing

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

A. 2 Sample Drawings(Cont.)



Fig. 10 Drawing of hardware
Page 17 of 20

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

A. 2 Sample Drawings(Cont.)

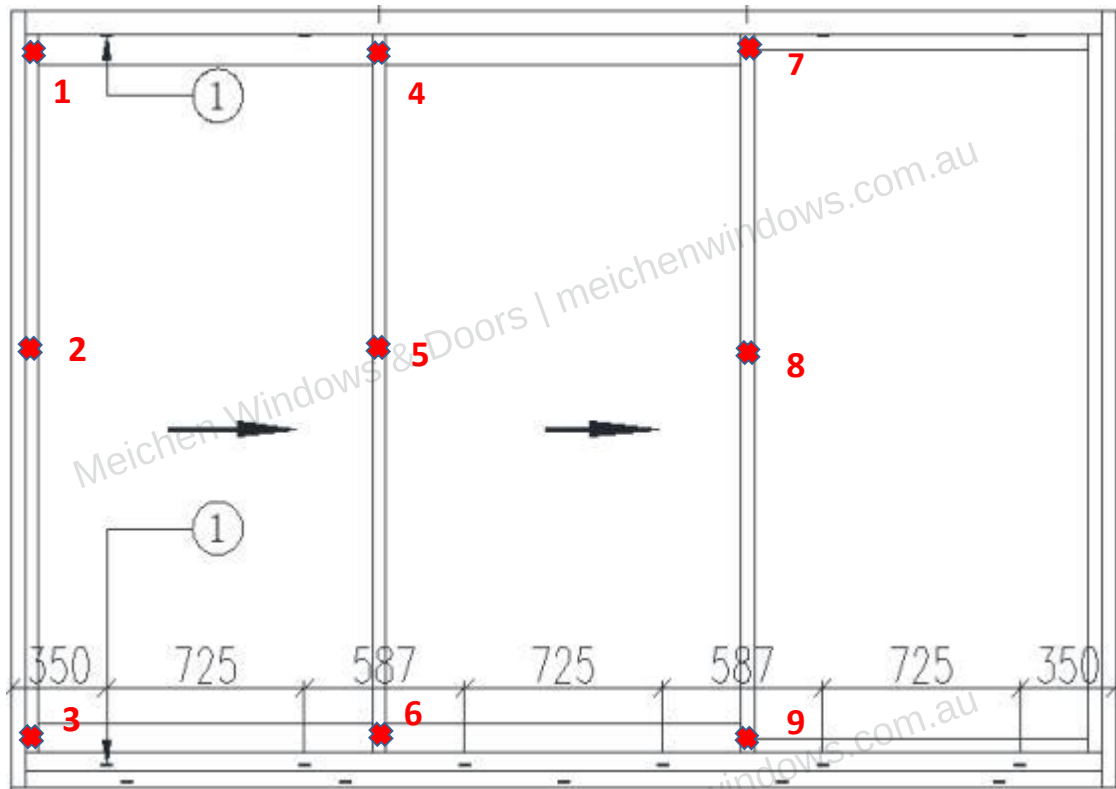


Fig. 1.1 Locations of Displacement Measuring Devices

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

A. 2 Sample Drawings(Cont.)

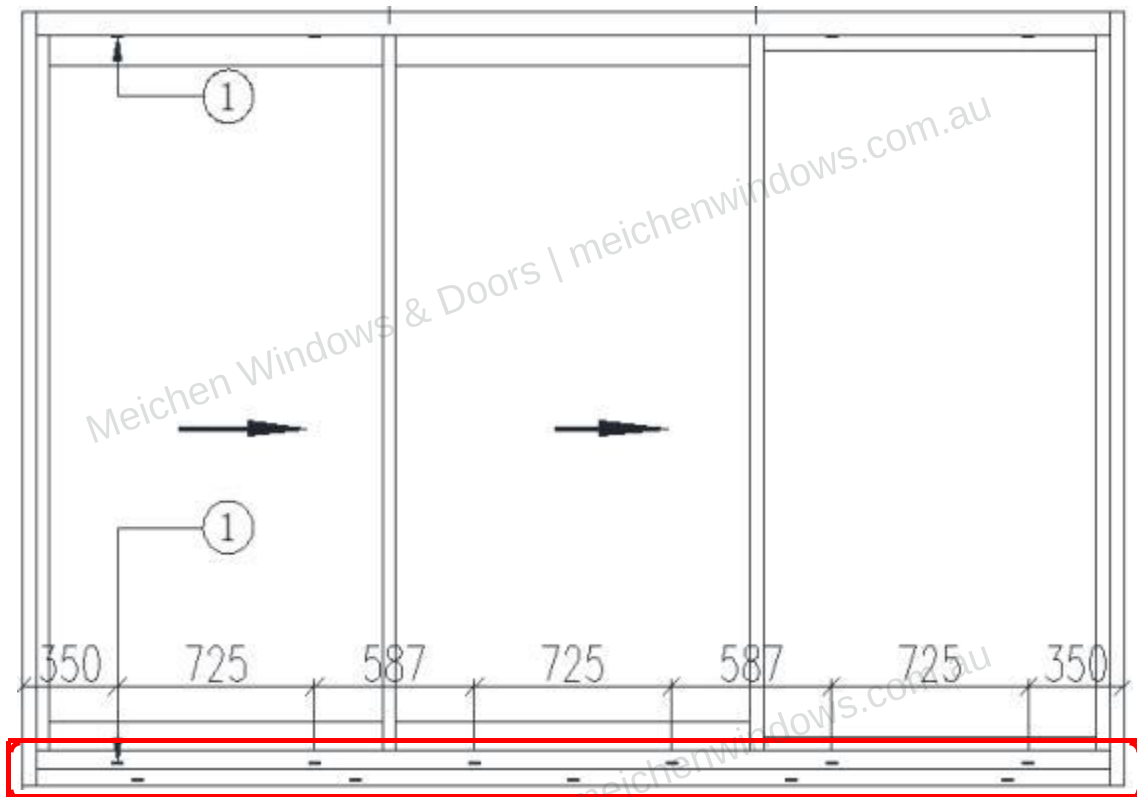


Fig. 12 Locations of water penetration

Test Report

Issue Date: 2022/4/7
005

Intertek Report No. 220223081GZU-

APPENDIX : SAMPLE RECEIVED PHOTO



REPORT AUTHORIZED

When signed with physical or electronic signature, the contents of this report have been prepared and approved per Intertek's quality process in accordance with ISO 17025.

Approved by:

Prepared by:

Oliver Zhu

Ziqing Chen

Name: Oliver Zhu
Title: Reviewer

Name: Ziqing Chen
Title: Project Engineer

Revision:

Report No.	Date	Revision Reason	Revision Summary	Author	Reviewer
220223081GZU-005	2022/4/7	/	First issue	Ziqing Chen	Oliver Zhu

End of Test Report